

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P208947

Luminaire Tested: **LDSQA6A45940D010TE LARH30NF 6LSQA1H**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P208947
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26623)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDSQA6A45940D010TE LARH30NF 6LSQA1H
Description: PORTFOLIO 6" SQUARE ADJUSTABLE REFLECTOR, ANGLE-CUT TRIM,
SELF-FLANGED, 30° NARROW FLOOD
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4102.2 lumens
Efficiency: N/A
Efficacy: 75.4 lumens/watt
Spacing Criteria (0/90/45): 0.57 / 0.57 / 0.55
Luminous Opening: Rectangular (W 0.5' x L: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 54.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P208947

CATALOG NUMBER: LDSQA6A45940D010TE LARH30NF 6LSQA1H

Luminous Intensity Polar Plot

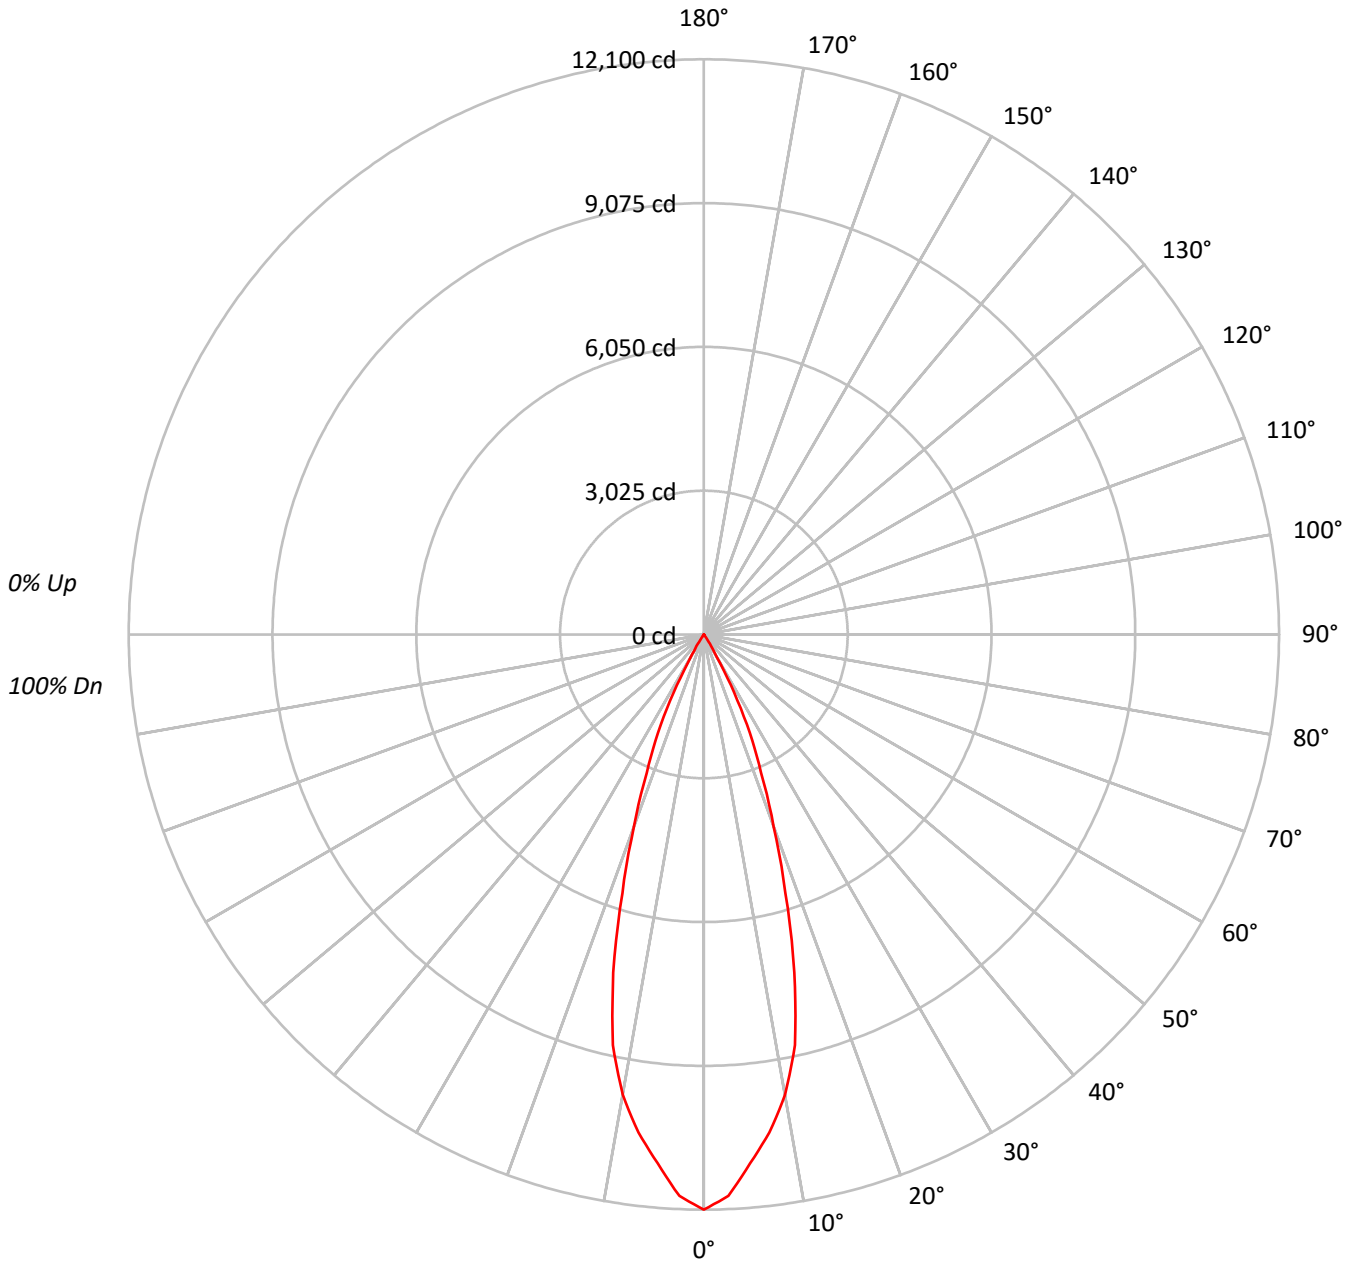



TEST NUMBER: P208947

CATALOG NUMBER: LDSQA6A45940D010TE LARH30NF 6LSQA1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96			
2	111	107	104	101	109	105	103	100	102	100	98	99	98	96	97	95	94	92			
3	107	102	98	95	105	101	97	95	98	95	93	96	94	92	94	92	90	89			
4	103	98	94	90	102	97	93	90	95	91	89	93	90	88	91	89	87	86			
5	100	94	89	86	99	93	89	86	91	88	85	90	87	84	88	86	84	83			
6	97	90	86	82	95	89	85	82	88	84	82	87	84	81	86	83	81	80			
7	94	87	82	79	93	86	82	79	85	81	79	84	81	78	83	80	78	77			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72			
10	85	78	74	71	84	78	74	71	77	73	71	76	73	70	76	73	70	69			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	520969
5°	482548
10°	429880
15°	328033
20°	196664
25°	108386
30°	26812
35°	2071
40°	585
45°	225
50°	100
55°	113
60°	129
65°	71
70°	88
75°	116
80°	174
85°	0



TEST NUMBER: P208947

CATALOG NUMBER: LDSQA6A45940D010TE LARH30NF 6LSQA1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1027.2	25.0
10°-20°	1969.2	48.0
20°-30°	1016.9	24.8
30°-40°	82.4	2.0
40°-50°	3.4	0.1
50°-60°	1.3	0.0
60°-70°	1.0	0.0
70°-80°	0.7	0.0
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4013.3	97.8
0°-40°	4095.6	99.8
0°-60°	4100.4	100.0
0°-90°	4102.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4102.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12100	
5°	11165	###
15°	7359	1969
25°	2282	1017
35°	39	82
45°	4	3
55°	2	1
65°	1	1
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P208947

CATALOG NUMBER: LDSQA6A45940D010TE LARH30NF 6LSQA1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	12099.9
2.5°	11823.9
5°	11164.9
7.5°	10564.6
10°	9832.6
12.5°	8848.4
15°	7359.2
17.5°	5705.5
20°	4292.2
22.5°	3146.6
25°	2281.5
27.5°	1373.9
30°	539.3
32.5°	229.1
35°	39.4
37.5°	19.3
40°	10.4
42.5°	6.0
45°	3.7
47.5°	2.2
50°	1.5
52.5°	1.5
55°	1.5
57.5°	1.5
60°	1.5
62.5°	1.5
65°	0.7
67.5°	0.7
70°	0.7
72.5°	0.7
75°	0.7
77.5°	0.7
80°	0.7
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)