

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P208963

Luminaire Tested: **LDSQA6A65940D010TE LARH30NF 6LSQA1H**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P208963
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26623)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDSQA6A65940D010TE LARH30NF 6LSQA1H
Description: PORTFOLIO 6" SQUARE ADJUSTABLE REFLECTOR, ANGLE-CUT TRIM,
SELF-FLANGED, 30° NARROW FLOOD
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5280.1 lumens
Efficiency: N/A
Efficacy: 67.1 lumens/watt
Spacing Criteria (0/90/45): 0.57 / 0.57 / 0.55
Luminous Opening: Rectangular (W 0.5' x L: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 78.67
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P208963

CATALOG NUMBER: LDSQA6A65940D010TE LARH30NF 6LSQA1H

Luminous Intensity Polar Plot

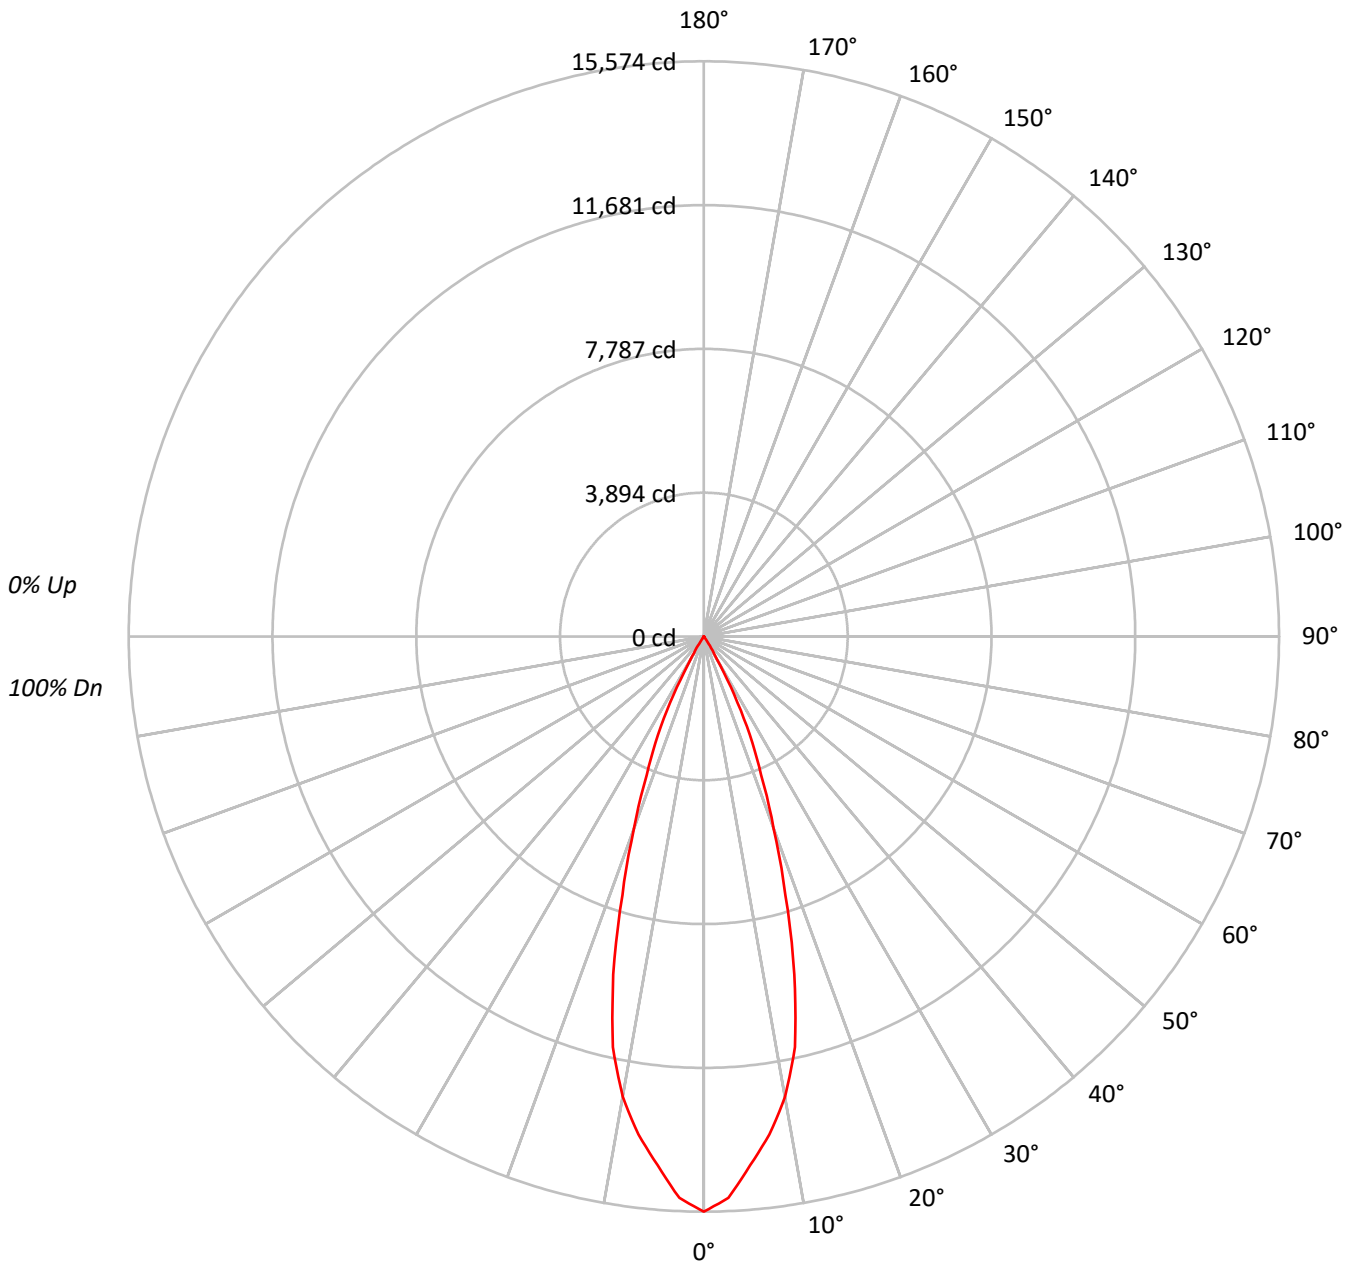



TEST NUMBER: P208963

CATALOG NUMBER: LDSQA6A65940D010TE LARH30NF 6LSQA1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | |
| 1 | 115 | 113 | 111 | 109 | 112 | 110 | 109 | 107 | 106 | 105 | 104 | 103 | 102 | 101 | 99 | 99 | 98 | 96 | | | |
| 2 | 111 | 107 | 104 | 101 | 109 | 105 | 103 | 100 | 102 | 100 | 98 | 99 | 98 | 96 | 97 | 95 | 94 | 92 | | | |
| 3 | 107 | 102 | 98 | 95 | 105 | 101 | 97 | 95 | 98 | 95 | 93 | 96 | 94 | 92 | 94 | 92 | 90 | 89 | | | |
| 4 | 103 | 98 | 94 | 90 | 102 | 97 | 93 | 90 | 95 | 91 | 89 | 93 | 90 | 88 | 91 | 89 | 87 | 86 | | | |
| 5 | 100 | 94 | 89 | 86 | 99 | 93 | 89 | 86 | 91 | 88 | 85 | 90 | 87 | 84 | 88 | 86 | 84 | 83 | | | |
| 6 | 97 | 90 | 86 | 82 | 95 | 89 | 85 | 82 | 88 | 84 | 82 | 87 | 84 | 81 | 86 | 83 | 81 | 80 | | | |
| 7 | 94 | 87 | 82 | 79 | 93 | 86 | 82 | 79 | 85 | 81 | 79 | 84 | 81 | 78 | 83 | 80 | 78 | 77 | | | |
| 8 | 91 | 84 | 79 | 76 | 90 | 83 | 79 | 76 | 82 | 78 | 76 | 81 | 78 | 75 | 80 | 77 | 75 | 74 | | | |
| 9 | 88 | 81 | 76 | 73 | 87 | 80 | 76 | 73 | 80 | 76 | 73 | 79 | 75 | 73 | 78 | 75 | 73 | 72 | | | |
| 10 | 85 | 78 | 74 | 71 | 84 | 78 | 74 | 71 | 77 | 73 | 71 | 76 | 73 | 70 | 76 | 73 | 70 | 69 | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 670540 |
| 5° | 621086 |
| 10° | 553297 |
| 15° | 422210 |
| 20° | 253126 |
| 25° | 139503 |
| 30° | 34508 |
| 35° | 2665 |
| 40° | 753 |
| 45° | 292 |
| 50° | 127 |
| 55° | 143 |
| 60° | 164 |
| 65° | 102 |
| 70° | 126 |
| 75° | 166 |
| 80° | 248 |
| 85° | 0 |



TEST NUMBER: P208963

CATALOG NUMBER: LDSQA6A65940D010TE LARH30NF 6LSQA1H

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 1322.1 | 25.0 |
| 10°-20° | 2534.5 | 48.0 |
| 20°-30° | 1308.9 | 24.8 |
| 30°-40° | 106.1 | 2.0 |
| 40°-50° | 4.3 | 0.1 |
| 50°-60° | 1.7 | 0.0 |
| 60°-70° | 1.3 | 0.0 |
| 70°-80° | 1.1 | 0.0 |
| 80°-90° | 0.1 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 5165.5 | 97.8 |
| 0°-40° | 5271.5 | 99.8 |
| 0°-60° | 5277.6 | 100.0 |
| 0°-90° | 5280.1 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 5280.1 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|-------|------|
| 0° | 15574 | |
| 5° | 14370 | ### |
| 15° | 9472 | 2534 |
| 25° | 2936 | 1309 |
| 35° | 51 | 106 |
| 45° | 5 | 4 |
| 55° | 2 | 2 |
| 65° | 1 | 1 |
| 75° | 1 | 1 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P208963

CATALOG NUMBER: LDSQA6A65940D010TE LARH30NF 6LSQA1H

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|---------|
| 0° | 15573.8 |
| 2.5° | 15218.6 |
| 5° | 14370.3 |
| 7.5° | 13597.6 |
| 10° | 12655.5 |
| 12.5° | 11388.8 |
| 15° | 9472.0 |
| 17.5° | 7343.6 |
| 20° | 5524.5 |
| 22.5° | 4050.0 |
| 25° | 2936.5 |
| 27.5° | 1768.4 |
| 30° | 694.1 |
| 32.5° | 294.9 |
| 35° | 50.7 |
| 37.5° | 24.9 |
| 40° | 13.4 |
| 42.5° | 7.7 |
| 45° | 4.8 |
| 47.5° | 2.9 |
| 50° | 1.9 |
| 52.5° | 1.9 |
| 55° | 1.9 |
| 57.5° | 1.9 |
| 60° | 1.9 |
| 62.5° | 1.9 |
| 65° | 1.0 |
| 67.5° | 1.0 |
| 70° | 1.0 |
| 72.5° | 1.0 |
| 75° | 1.0 |
| 77.5° | 1.0 |
| 80° | 1.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)